
All TSOs' proposal for a methodology for assessing the relevance of assets for outage coordination in accordance with Article 84 of Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation.

26 February 2018

Disclaimer

This document, provided by all Transmission System Operators (TSOs), is the draft for stakeholder consultation of the all TSOs' proposal for the methodology for assessing the relevance of assets for outage coordination in accordance with article 84 of Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation.

All TSOs, taking into account the following:

Whereas

- (1) This document is a common proposal developed by all Transmission System Operators (hereafter referred to as “TSOs”) regarding the development of a proposal for a Methodology for assessing the relevance of assets for outage coordination (hereafter referred to as "Outage Coordination Asset Assessment Methodology Proposal" or “Methodology”).
- (2) This Methodology takes into account the general principles and goals set in Commission Regulation (EU) 2017/1485 of 2 August 2017 establishing a guideline on electricity transmission system operation (hereafter referred to as “SO GL”) as well as 2015/1222 establishing a guideline on capacity allocation and congestion management (hereafter referred to as “Regulation 2015/1222”), and Regulation (EC) No 714/2009 of the European Parliament and of the Council of 13 July 2009 on conditions for access to the network for cross-border exchanges in electricity (hereafter referred to as “Regulation (EC) No 714/2009”). The goal of SO GL is to safeguard operational security, frequency quality and the efficient use of the interconnected system and resources. To facilitate these aims, it is necessary -for outage coordination- to standardise, at least per synchronous area, the identification of relevant assets for outage coordination process organised per outage coordination regions, which are deemed at least equal to capacity calculation regions pursuant to Article 80 of SO GL. Since these outage coordination regions may cover TSOs located in different synchronous areas, the standardization is better established at a pan-European level.
- (3) Article 84 of SO GL constitutes the legal basis for the Outage Coordination Asset Assessment Methodology Proposal. This Article requires the Methodology to be based on qualitative and quantitative aspects to determine the relevance of assets - that are either in a transmission system or distribution system, including closed distribution system - to be taken into account in the coordinated regional outage planning process in order to evaluate the impact of their planned outage on the interconnected transmission system secure operation. Those aspects shall be based “*in particular on: (a) quantitative aspects based on the evaluation of changes of electrical values such as voltages, power flows, rotor angle on at least one grid element of a TSO's control area, due to the change of availability status of a potential relevant asset located in another control area. That evaluation shall take place on the basis of year-ahead common grid models; (b) thresholds on the sensitivity of the electrical values referred to in point (a), against which to assess the relevance of an asset. Those thresholds shall be harmonised at least per synchronous area; (c) capacity of potential relevant power generating modules or demand facilities to qualify as SGUs; (d) qualitative aspects such as, but not limited to, the size and proximity to the borders of a control area of potential relevant power generating modules, demand facilities or grid elements; (e) systematic relevance of all grid elements located in a transmission system or in a distribution system which connect different control areas; and (f) systematic relevance of all critical network elements*”. Article 84 equally requires that “*The methodology shall be consistent with the methods for assessing the influence of transmission system elements and SGUs located outside of a TSO's control area established in accordance with Article 75(1)(a).*”

In order to achieve this last requirement, the provisions of the Outage Coordination Asset Assessment Methodology Proposal are therefore closely aligned with the common influence computation method developed under Article 75(1)(a) of SO GL.

- (4) According to Article 6 (6) of the SO GL, the expected impact of the CSA Methodology Proposal on the objective of the SO GL has to be described. It is presented below. The Outage Coordination Asset Assessment Methodology Proposal generally contributes to the achievement of the objectives of the SO GL. In particular the Methodology serves the objective of maintaining operational security throughout the Union, specifically coordination of system operation and operational planning; transparency and reliability of information on transmission system operation; and the efficient operation of the electricity transmission system in the Union.
- (5) Furthermore, the Outage Coordination Asset Assessment Methodology Proposal shall ensure application of the principles of proportionality and non-discrimination; transparency; optimisation between the highest overall efficiency and lowest total costs for all parties involved; and use of market-based mechanisms as far as possible, to ensure network security and stability.
- (6) In conclusion, the Outage Coordination Asset Assessment Methodology Proposal shall contribute to the general objectives of the SO GL to the benefit of all TSOs, the Agency, regulatory authorities and market participants.

SUBMIT THE FOLLOWING OUTAGE COORDINATION ASSET ASSESSMENT METHODOLOGY PROPOSAL TO ALL REGULATORY AUTHORITIES:

TITLE 1

General Provisions

Article 1

Subject matter and scope

1. The methodology described in this proposal is the common proposal of all TSOs in accordance with Article 84 of SO GL.
2. This methodology shall cover the relevance assessment of assets for outage coordination requirements defined in Title 3 of SO GL and it applies to all TSOs, DSOs, CDSOs and SGUs as defined in Article 2 of SO GL.
3. TSOs from jurisdictions outside the area referred to in Article 1(2) of SO GL may participate in the relevance assessment of assets for outage coordination on a voluntary basis, provided that
 - a. for them to do so is technically feasible and compatible with the requirements of SO GL;
 - b. they agree that they shall have the same rights and responsibilities with respect to the relevance assessment of assets for outage coordination as the TSOs referred to in paragraph 2;
 - c. they accept any other conditions related to the voluntary nature of their participation in the relevance assessment of assets for outage coordination that the TSOs referred to in paragraph 2 may set;

- d. the TSOs referred to in paragraph 2 have concluded an agreement governing the terms of the voluntary participation with the TSOs referred to in this paragraph;
 - e. once TSOs participating in the relevance assessment of assets for outage coordination on a voluntary basis have demonstrated objective compliance with the requirements set out in (a), (b), (c), and (d), the TSOs referred to in paragraph 2, after checking that the criteria in (a), (b), (c), and (d) are met, have approved an application from the TSO wishing to participate on a voluntary basis in accordance with the procedure set out in Article 5(3) of the SO GL.
4. The TSOs referred to in paragraph 2 shall monitor that TSOs participating in relevance assessment of assets for outage coordination on a voluntary basis pursuant to paragraph 3 respect their obligations. If a TSO participating in the relevance assessment of assets for outage coordination pursuant to paragraph 3 does not respect its essential obligations in a way that significantly endangers the implementation and operation of SO GL, the TSOs referred to in paragraph 2 shall terminate that TSO's voluntary participation in the relevance assessment of assets for outage coordination process in accordance with the procedure set out in Article 5(3) of SO GL.

Article 2

Definitions and interpretation

1. For the purposes of this methodology, the terms used shall have the meaning of the definitions included in Article 2 of SO GL, Article 2 of Regulation 2015/1222 and the other items of legislation referenced therein.
2. Where this Methodology refers to grid elements, it includes HVDC systems and HVDC interconnectors.
3. The Outage Coordination Region shall be considered equal to the Capacity Calculation Region unless all concerned TSOs agree to merge two or more outage coordination regions into one unique outage coordination region.

TITLE 2

Determination of relevant assets

Article 3

Influence computation method

1. The influence computation method has the following characteristics:
 - a. It is able to characterize the influence of the absence of one network element, being a grid element, a power generation module, a demand facility connected to a TSO or transmission-connected DSO/CDSO network on the power flow or voltage of another grid element
 - b. It is applicable on network models such as a year-ahead common grid model developed in accordance to Article 67 of SO GL or on other similar network models in terms of needed data
 - c. The influence is characterized with respect to the relative or absolute value of power flow or voltage variation and the result is able to be compared against thresholds

2. Each TSO shall apply the influence computation method provided in Annex I for computing power flow influence factors on its control area of grid elements, power generating modules, and demand facilities located outside the TSO's control area, at least for those grid elements, power generating modules, and demand facilities connected to a transmission system.
3. Each TSO shall have the right to use voltage influence factors for determination of its proposal of relevant assets.
4. Where applicable according to paragraph 3, each TSO shall apply the influence computation method referred to in paragraph 1 for computing voltage influence factors on its control area of grid elements, power generating modules, and demand facilities located outside its control area.
5. TSOs may agree to use dynamic studies for assessing influence of the grid elements, power generating modules, and demand facilities located outside their control areas. In such case, they shall define models, studies and criteria to be used for the assessment and inform their NRAs about their agreement. These models and studies shall be consistent with those developed in application of Articles 38 or 39 of SO GL.
6. Each TSO may decide to use dynamic studies for assessing influence of the grid elements, power generating modules, and demand facilities located in transmission-connected DSOs/CDSOs grids. In such a case, the TSO shall use models, studies and criteria, consistent with those developed in application of Articles 38 or 39 of SO GL, and in the case where one or more elements are identified as relevant, the concerned TSO shall inform its NRA of the elements identified with reasoning supporting this result.
7. Each TSO shall inform the concerned transmission-connected DSOs/CDSOs about the decision to compute power flow and/or voltage influence factor of grid elements of their systems or power generating modules and demand facilities connected to the DSO/CDSO system and shall be entitled to ask these DSOs/ CDSOs for technical parameters and data that can allow the inclusion of at least part of their grids in the TSO's grid models.
8. Each TSO shall inform the concerned transmission-connected DSOs/CDSOs about the decision to use dynamic studies to assess influence of the grid elements, power generating modules, and demand facilities located in transmission-connected DSOs/CDSOs grids and shall be entitled to ask these DSOs/ CDSOs for the corresponding technical parameters and data.
9. When requested according to paragraphs 7 and 8, each transmission-connected DSO/CDSO shall provide a coherent set of data to enable the connecting TSO to incorporate the required part of their systems in its individual grid models established pursuant to paragraph 11.
10. Each TSO shall use the common grid models established according to Article 67 of the System Operation Guidelines, and complemented as needed pursuant to paragraph 11, when computing power flow and/or voltage influence factors of grid elements, power generating modules and demand facilities connected directly or through a DSO/CDSO to another TSO's control area.
11. Each TSO shall include in its individual grid model relevant data model required according to paragraphs 9 and 10 which it identifies as necessary for computation of influence factors by another TSO.

Article 4

Identification of relevant assets for outage coordination

1. Each TSO shall define its proposition of relevant assets in accordance with Article 3.
2. Each TSO shall select threshold values inside the range of relevant assets thresholds listed in Annex 1 that it shall use to determine its proposition of relevant assets in application of paragraph 1. The TSO shall publish on its web site those threshold values in time with the application of paragraph 1.
3. Each TSO shall include in its proposition of relevant assets:
 - a. all grid elements outside its control area which have at least one influence factor higher than the correspondent relevant asset threshold values selected pursuant to paragraph 2;
 - b. all grid elements of a transmission-connected DSO/CDSO to another TSO's control area, which have at least one influence factor higher than the correspondent relevant asset threshold values selected pursuant to paragraph 2;
 - c. elements identified in application of Article 3(3), to Article 3(8), where applicable;
 - d. all grid elements connecting this TSO's control area to another TSO's control area;
 - e. all the Type D power generating modules and demand facilities outside its control area, which are included in its observability area, are SGUs and have at least one influence factor higher than the correspondent relevant asset threshold listed in Annex 1. The TSO shall have the right to limit these elements to those higher than 100 MW.
4. In coordination with other TSOs of the outage coordination region it is part of, each TSO shall have the right also to include in its proposition of relevant assets:
 - a. combinations of more than one grid elements outside its control area whose simultaneous outage can be necessary for any particular material or system reason and which can threaten the system security of its control area;
 - b. grid elements outside its control area whose outage can have an impact on the operation of DC links between synchronous areas;
 - c. grid elements outside its control area whose outage can have an impact on the operation of its control area, such as stability, function of protections, short-circuit assessment.
5. By 3 months after the approval of this methodology, and when necessary after that, all TSOs of an outage coordination region shall define the common list of relevant assets to be coordinated in this outage coordination region. This list shall include all elements being grid elements, power generating modules, and demand facilities proposed as relevant asset in accordance to paragraph 3 and 4 by at least one TSO belonging to this outage coordination region and which is located in a TSO's control area belonging to this outage coordination region, except elements excluded upon a common agreement between TSOs of the outage coordination region.
6. All TSOs of an outage coordination region shall complement the list identified according to paragraph 5 with the critical network elements identified in accordance with Regulation (EU) No 2015/1222 for the

relevant outage coordination region, and provided that their status of critical network element is sufficiently stable along the year.

7. The update of relevant assets lists in accordance to Articles 86(1) and 88(1) of SO GL may be performed on a qualitative basis according to new information regarding relevant changes expected or incurred in the grid structure or on generation modules and demand facilities.
8. All TSOs of each outage coordination region shall jointly re-assess the relevance of external grid elements, power generating modules and demand facilities for outage coordination in accordance with paragraph 1 to 5 at least once every 5 years after the first assessment.
9. The assessment of the relevance of elements for outage coordination commissioned between two mandatory relevance assessments in accordance to paragraph 7 may be performed in a qualitative way.
10. If the owner of the new element disagrees with such a qualitative approach, TSOs shall use the influence computation method in accordance to the Article 3 for establishing the relevance of such elements for outage coordination.

Article 5

Timescale for implementation

1. Upon approval of the present methodology each TSO shall publish it on the internet in accordance with Article 8(1) of SO GL.

Article 6

Language

1. The reference language for this Methodology shall be English. For the avoidance of doubt, where TSOs need to translate this proposal into their national language(s), in the event of inconsistencies between the English version published by TSOs in accordance with Article 8(1) of SO GL and any version in another language the relevant TSOs shall, in accordance with national legislation, provide the relevant national regulatory authorities with an updated translation of the proposal.

Annex I

AI.1 Influence threshold

Power flow influence factor is evaluated by computing two elementary factors: power flow identification influence factor and power flow filtering influence factor. These factors are defined in AI.2.

Set of elements	Power flow identification influence threshold	Power flow filtering influence threshold	Voltage influence threshold
Relevant Asset	15 – 25%	3 - 5%	0.03 – 0.05 pu

AI.2 Influence Computation Method

In order to compute influence of elements located outside TSOs control area on a given control area following definitions have to be introduced (Figure 1):

- Element t is an element located in TSOs control area and which is influenced by an element located outside TSOs control area;
- Element r is an element located outside TSOs control area whose influence is assessed;
- Elements i are elements located either in TSOs control area or outside TSOs control area which are disconnected to represent planned (or forced) outages.

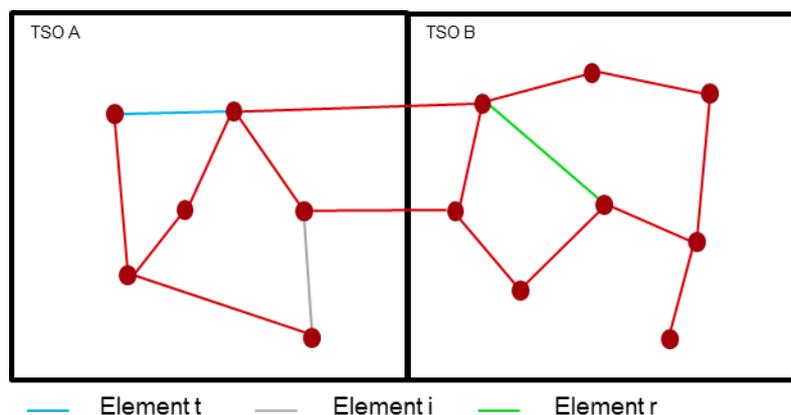


Figure 1

AI.2.1.1 Grid elements

The influence of an element (r) shall be assessed by each TSO using following formulas:

$$IF_r^{pf,id} = MAX_{\forall i \in I, \forall s, \forall t \in T} \left(\frac{P_{s,n-i-r}^t - P_{s,n-i}^t}{P_{s,n-i}^r} \cdot \frac{PATL^{s,r}}{PATL^{s,t}} \cdot 100 \right)$$

$$IF_r^{pf,f} = MAX_{\forall i \in I, \forall s, \forall t \in T} \left(\frac{P_{s,n-i-r}^t - P_{s,n-i}^t}{P_{s,n-i}^r} \cdot 100 \right)$$

Where

$IF_r^{pf,id}$: power flow identification influence factor of an element r on an element t of the given control area; the factor is normalized in order to take into account potential impacts induced by differences in PATL values;

$IF_r^{pf,f}$: power flow filtering influence factor of an element r on an element t of the given control area; this factor is not normalized

s: scenarios (year-ahead scenarios developed according to SO GL). Setting of HVDC links and PSTs in the different scenarios are assumed to be already defined, in a coherent way, in the context of the scenarios/CGMs development process.

t: Element located inside TSOs control area where the active power difference is observed;

T: Set of elements of the TSO's control area, which are part of CGM and for which the assessment is performed

i: Element located either in TSOs control area or outside TSOs control area (different from elements r and t) considered disconnected from the network when assessing the formula;

I: Set of elements, located either in TSOs control area or outside TSOs control area, modelled in the grid model whose possible outage should be taken into account in the assessment.;

r: Element located outside TSOs control area whose power flow influence factor is assessed;

R: Set of elements located outside TSOs control area to be assessed

P_n^t : Active power through the element t with the element r connected to the network and the element i disconnected from the network;

P_n^r : Active power through the element r, when connected to the network, considering the element i disconnected from the network;

P_{n-i}^t : Active power through the element t with the element r and the element i disconnected from the network;

$PATL^{s,t}$: Permanently Admissible Transmission Loading is the loading in Amps, MVA or MW that can be accepted by element t in the scenario s for an unlimited duration;

$PATL^{s,r}$: Permanently Admissible Transmission Loading is the loading in Amps, MVA or MW that can be accepted by element r in the scenario s for an unlimited duration. If r is a combination of more than one element, the sum of the PATL values is considered.

NB: those computations have to be done inside one synchronous area. By principle, $IF_r^{pf,id}$ and $IF_r^{pf,f}$ are equal to 0 when r and t are not located in the same synchronous area.

The formulas must be applied, for each element r which belongs to the set R , assessing its influence on every element t of the TSO's control area for which the assessment is performed, and considering possible outages (element i) (Figure 1).

The influence factor of an element connected in a given synchronous area on another element connected in a different synchronous area shall be equal to 0. Outages of HVDC links inside of a synchronous area are treated as outages of AC elements.

Each TSO shall classify the "r" element as selected for its proposition of relevant assets when the following conditions are simultaneously satisfied:

Power flow identification influence factor > Chosen-threshold1

Power flow filtering influence factor > Chosen-threshold2

where Chosen-threshold1 and Chosen-threshold2 are uniquely chosen by the TSO inside the ranges provided above in AI.1

AI.2.1.2 Significant Grid Users

Power flow influence factor for generating modules and demand facilities can be computed using the same formula adopted for grid elements, considering them as the element r and assuming:

P_n^t : Active power through the element t with the generating module or demand facility r (located outside TSOs control area) connected to the network and the element i disconnected from the network;

P_n^r : Active power infeed (generated by the generating module or consumed demand facility r), when connected to the network, considering the element i disconnected from the network;

P_{n-i}^t : Active power through the element t with the generating module or demand facility r and the element i disconnected from the network;

$PATL^{s,t}$: Permanently Admissible Transmission Loading is the loading in, MVA or MW that can be accepted by element t in the scenario s for an unlimited duration;

$PATL^{s,r}$: installed capacity in MW or MVA of the generating module or demand facility r in the scenario s .

AI.2.2 Voltage influence factor

If a TSO decides to use voltage influence factors in the determination of its proposition of relevant assets, the influence of an element r shall be assessed using following formula:

$$IF_r^v = \text{MAX}_{\forall s, \forall m(m \in M)} \left(\left| \frac{V_{s,n-1}^{m,r} - V_{s,n}^m}{V_{base}^m} \right| \right)$$

Where:

IF_r^v : Voltage influence factor of an grid element r on a node m of the given control area;

s : Scenarios (year-ahead scenarios developed according to SO GL) which are relevant for influence criteria.

r : Element located outside TSOs control area whose voltage influence factor is assessed;

R : Set of grid elements r to be assessed

$V_{s,n-1}^{m,r}$: Voltage at node m with the element r disconnected from the network;

$V_{s,n}^m$: Voltage at node m with the element r connected to the network;

V_{base}^m : Nominal voltage in the node m .

The formula must be applied, for each element r which belongs to the set R , assessing its influence on every node n of the given control area. The voltage influence factor of an element r is the maximum value of the previous calculations.

Hence, the influence factor on voltage is the maximum Voltage Deviation on any internal node m resulting from the outage of an element r in any scenario. For a sake of simplicity, voltage is expressed in per unit. Contrary to the influence of flows, the influence on voltage of an element is highly dependent on the load/generation pattern i.e. the active and reactive load of the element in the investigated scenarios.

Where a TSO intends to use voltage influence factors, the TSO shall classify the “ r ” element as selected for its proposition of relevant assets when the following condition is satisfied:

Voltage influence factor > Chosen-threshold

where Chosen-threshold is uniquely chosen by the TSO inside the ranges provided above in AI.1